WWTP type CC 800, ref: Camping France 2007

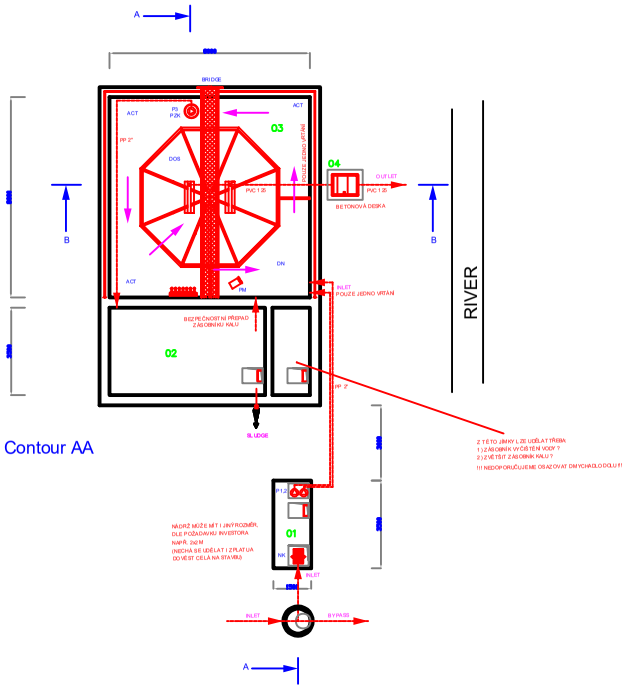

Contour AA

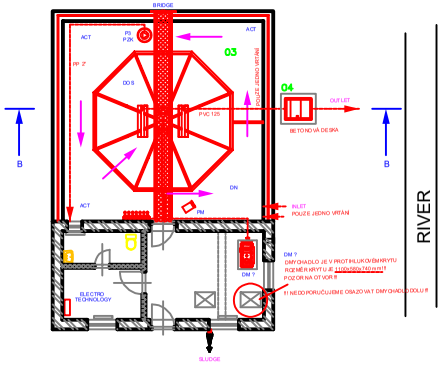

Contour BB

Cut B-B

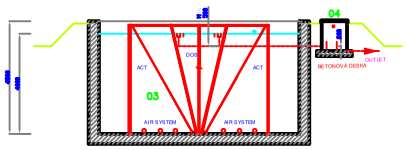

Cut A-A

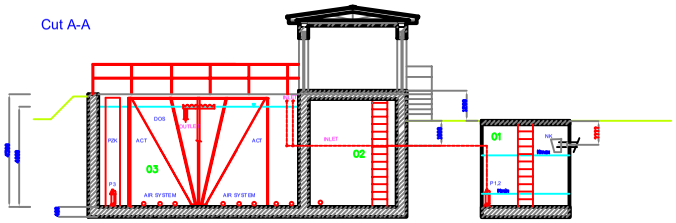

FROM SEPTICTANK NO 1 and No 2:

Average daily inflow: Q24= 120,0 m3 per day

Max daily inflow: Q24= 180,0 m3 per day

Max inflow per hour: Q24= 15,0 m3 - 4,2 l/s

01 - PUMP SUMP
02 - SLUDGE TANK
03 - WWTP
04 - MEASURING OBJECT

DN	- DENITRIFICATION
ACT	- ACTIVATION
DOS	- SEPARATION
PZK	- PRE-THICKENER
P1,2	- PUMP OF SEWAGE
P3	- PUMP OF SLUDGE
PM	- MIXER
DM	- BLOWER
NK	- SCREEN STRAINER